NOTE:
CROSS TIES SHALL BE PLACED AT ALTERNATE
VERTICAL BARS AND BE SPACED AT 610 mm MAX.
HORIZONTALLY AND 300 mm MAX. VERTICALLY.

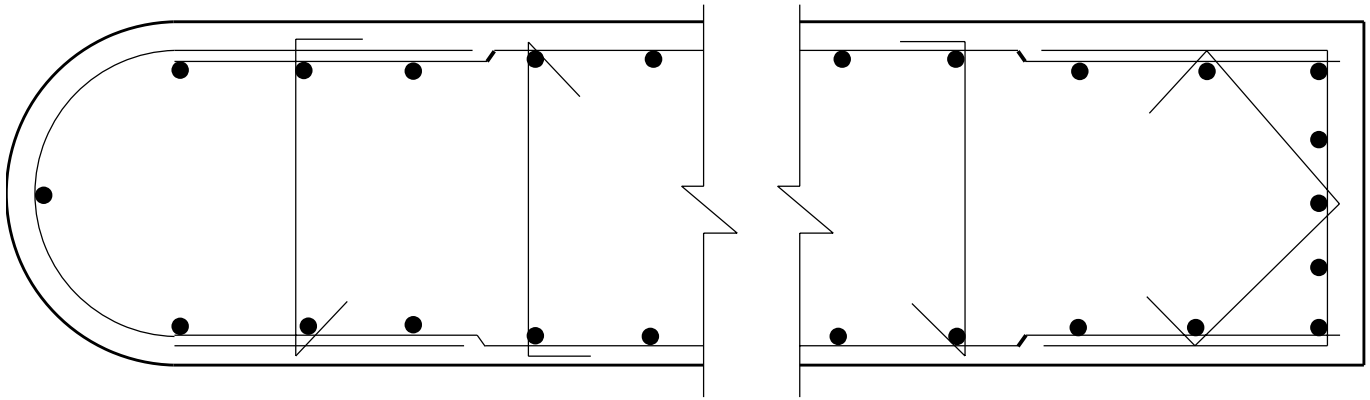

ROUND NOSE

SQUARE NOSE

SUGGESTED REINFORCING DETAILS FOR WALL OR HAMMERHEAD
PIER IN SEISMIC ZONE 1
Figure 67-3F