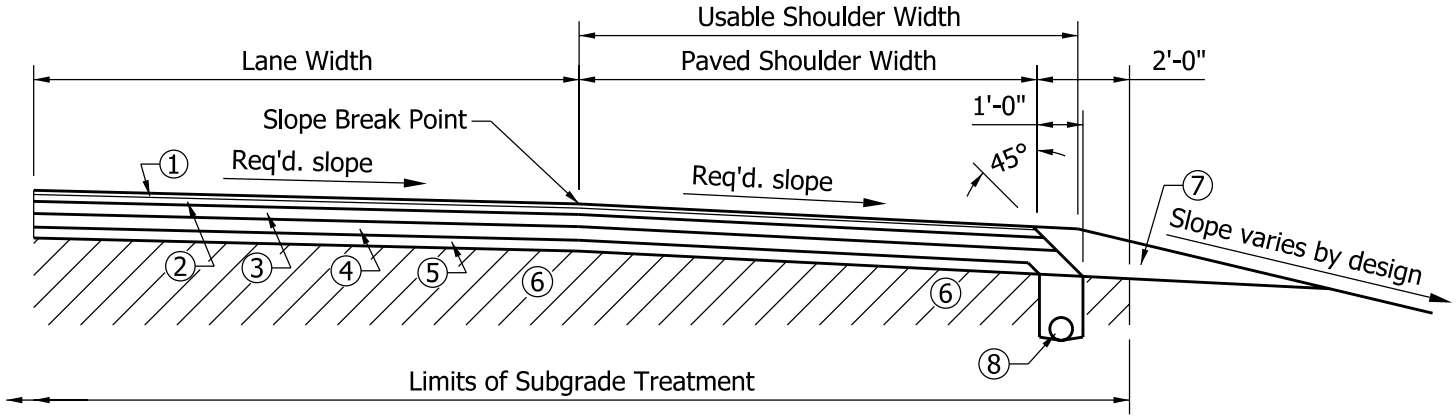

* <u>All Pavement, Including All Shoulders.</u> Configuration for Median Shoulder is the same as for an outside sholder.

1. 165 lb/yd² HMA Surface 9.5 mm
2. 275 lb/yd² HMA Intermediate 19.0 mm
3. 440 lb/yd² Minimum HMA Base 25.0 mm
4. ** 250 lb/yd² QC/QA-HMA Intermediate OG19.0 mm
5. 440 lb/yd² HMA Base 25.0 mm
6. Subgrade Treatment. Type _____
7. Variable-Depth Compacted Aggregate, Size No. 53
8. Pipe, Type 4, Circular, 6 in.

* Open graded mixtures OG19.0 mm should be QC/QA-HMA, 5, 76. For all other mixtures, see Section 52-9.02 to determine the appropriate HMA mixture designation.

** If underdrain warrants are not satisfied, Intermediate OG19.0 mm mix should be replaced with 275 lb/yd² HMA Base 25.0 mm.

FULL-DEPTH HMA PAVEMENT WITH FULL-DEPTH SHOULDER

Figure 52-13A