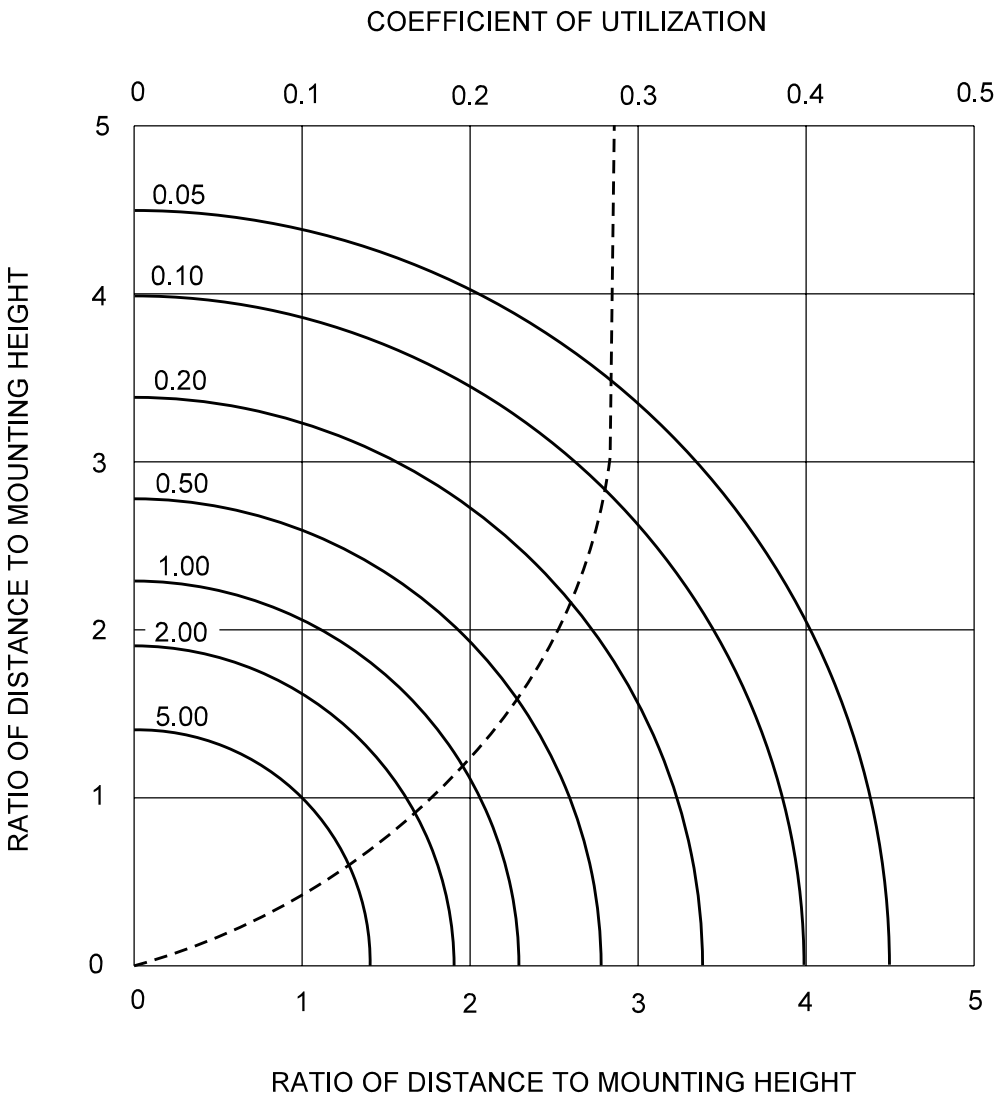

Note: Isolux diagram of horizontal lux on pavement surfaces for a luminaire providing a medium semi-cutoff, Type III light distribution (per 1000 initial lamp lumens). The isolux multiply data are based on a luminaire mounting height of 100 ft. For other mounting heights,the values of isolux shown by the factors below.

Mounting Height (ft):	*60*	*70*	*80*	*90*	*100*	*110*	*120*
Factor:	*2.78*	*2.04*	*1.56*	*1.23*	*1.00*	*0.83*	*0.69*

SAMPLE ISOLUX DIAGRAM
(Example 78-8.2)

Figure 78-8F