

= 12" min. for fill height of 16' or more

= Backfill length measured from toe to toe of the 2:1 slopes.

= Trench cover depth over pipe = 0.3 B_c or 9", whichever is greater


Encasement

SECTION A-A ROCK FOUNDATION

Structure backfill

NOTES:

- 1. Protective cover shall be constructed prior to running heavy equipment over installed pipes. The minimum covers are listed below:
 - a.) 1.5' for $B_c \le 18''$
 - b.) 3' for $18'' < B_c \le 54''$
 - c.) 4' for $B_c > 54''$
- (2) For backfill purposes, paved shoulders, curbs, and sidewalks are considered pavement. See Standard Drawing E 715-BKFL-10 for pavement limits when curbs, paved shoulders, or sidewalks are present.
- 3. Flowable or structure backfill shall be encased by compacted earth backfill. The minimum encasement shall be 2 ft. If necessary, the 2:1 slope between the flowable or structure backfill and the encasement shall be modified to maintain the minimum 2 ft encasement.

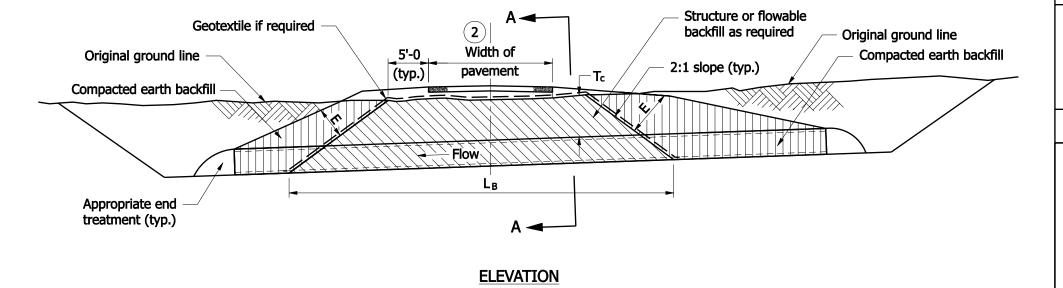


INDIANA DEPARTMENT OF TRANSPORTATION

PIPE BACKFILL METHOD 1 **NEW ROADWAY, TRENCH**

SEPTEMBER 2008

STANDARD DRAWING NO. E 715-BKFL-01



/s/Richard L. VanCleave 09/02/08 **DESIGN STANDARDS ENGINEER**

/s/ Mark A. Miller 09/02/08 CHIEF HIGHWAY ENGINEER

DATE

DATE