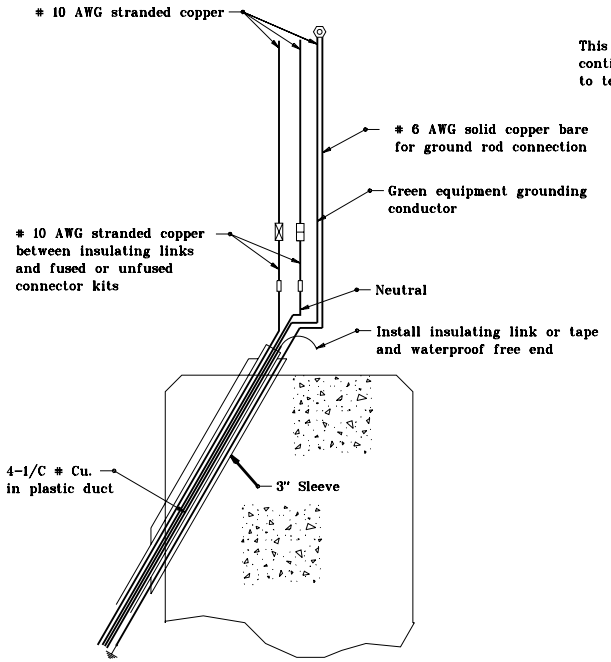

TYPE 1

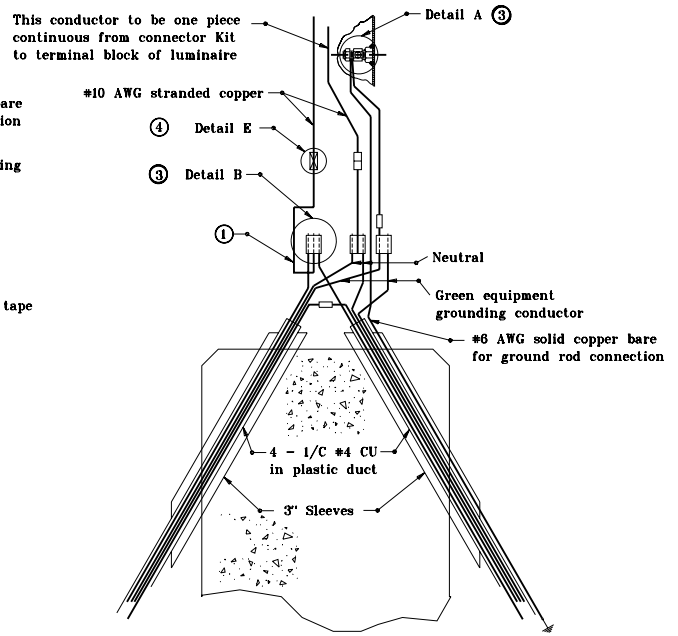

TYPE 2

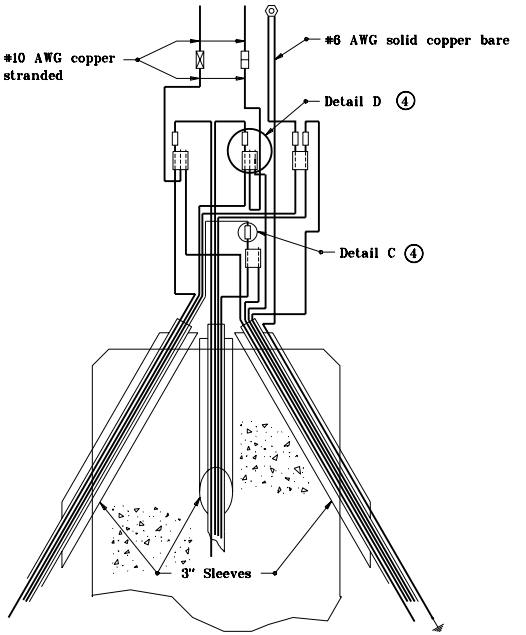

TYPE 3

CONNECTION TYPES

NOTES

1. Allow sufficient conductor slack to permit the withdrawal of outside of pole handhole.
2. Use of inhibiting compound is mandatory for all connections.
3. See Standard Drawing E 807-LTWR-02 for details.
4. See Standard Drawing E 807-LTWR-03 for details.

LEGEND

- Grounding post
- Self insulated splicer (insulating link)
- Unfused connector
- Fused connector
- Compression connector

INDIANA DEPARTMENT OF TRANSPORTATION

LIGHTING WIRING DETAILS

JANUARY 1996

STANDARD DRAWING NO. E 807-LTWR-01

ANTHONY L. UREMOVICH REGISTERED No. 18095 STATE OF INDIANA PROFESSIONAL ENGINEER

DESIGN STANDARDS ENGINEER

DETAILS PLACED IN THIS FORMAT	11-15-99
/s/ Anthony L. Uremovich DESIGN STANDARDS ENGINEER	11-15-99 DATE
/s/ Firooz Zandi CHIEF HIGHWAY ENGINEER	11-15-99 DATE
ORIGINALLY APPROVED	1-02-96