


My name is Karl P. Reichold, I am the owner of Hoops Sports Bar and Restaurant. I would like to appeal the attached Inspection Order. I will send a application for a variance. Please let me know if you need any other info.

Thank you,

Handwritten signature of Karl P. Reichold in cursive script.

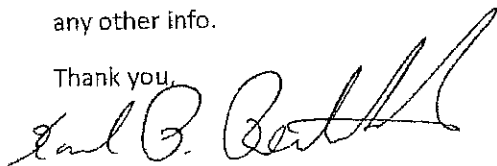

FIRE AND BUILDING CODE ENFORCEMENT INSPECTION REPORT ORDER

DIVISION OF FIRE AND BUILDING SAFETY
INDIANA DEPARTMENT OF HOMELAND SECURITY
302 WEST WASHINGTON STREET, RM E241
INDIANAPOLIS, IN 46204
TELEPHONE: 317-232-2222
WEB ADDRESS: WWW.IN.GOV/DHS

Identification Number BU25192	Name of the facility HOOPS	County CLINTON
Address of Property 1601 ROSSVILLE AVE FRANKFORT 46041	Name of the Contact KARL REICHOLD	Telephone Number (765) 242-9123
Email hoopsagain@sbcglobal.net	Inspection Date 03/31/2017	
Inspection Category BUSINESS/MANUFACTURING	Inspection Type REINSPECTION	Inspection Status: VIOLATION
Name of the inspector DEL SCHROEDER	Phone: 3174176654	
Email: dschroeder@dhs.in.gov		

Violations

VIO-LATION NUMBER	RULE OR INDIANA CODE SECTION VIOLATED	DESCRIPTION OF VIOLATION	DATE BY WHICH VIOLATION MUST BE CORRECTED
1	2009 Edition IEC 675 IAC 17-1.8	<p>240.24 Location in or on Premises.</p> <p>(A) Accessibility. Overcurrent devices shall be readily accessible and shall be installed so that the center of the grip of the operating handle of the switch or circuit breaker, when in its highest position, is not more than 2.0 m (6 ft 7 in.) above the floor or working platform.</p> <p><u>Accessible, Readily (Readily Accessible). Capable of being reached quickly for operation, renewal, or inspections without requiring those to whom ready access is requisite to climb over or remove obstacles or to resort to portable ladders, and so forth.</u></p> <p><u>Electric panel located in ceiling.</u></p>	04/30/2017
2	2009 Edition IEC 675 IAC 17-1.8	<p>240.33 Vertical Position. Enclosures for overcurrent devices shall be mounted in a vertical position unless that is shown to be impracticable. Circuit breaker enclosures shall be permitted to be installed horizontally where the circuit breaker is installed in accordance with 240.81. Listed busway plug-in units shall be permitted to be mounted in orientations corresponding to the busway mounting position.</p> <p><u>Electric panel located in ceiling.</u></p>	04/30/2017

Facility id BU25192	Received By Name	Signature and Date
-------------------------------	------------------	--------------------