


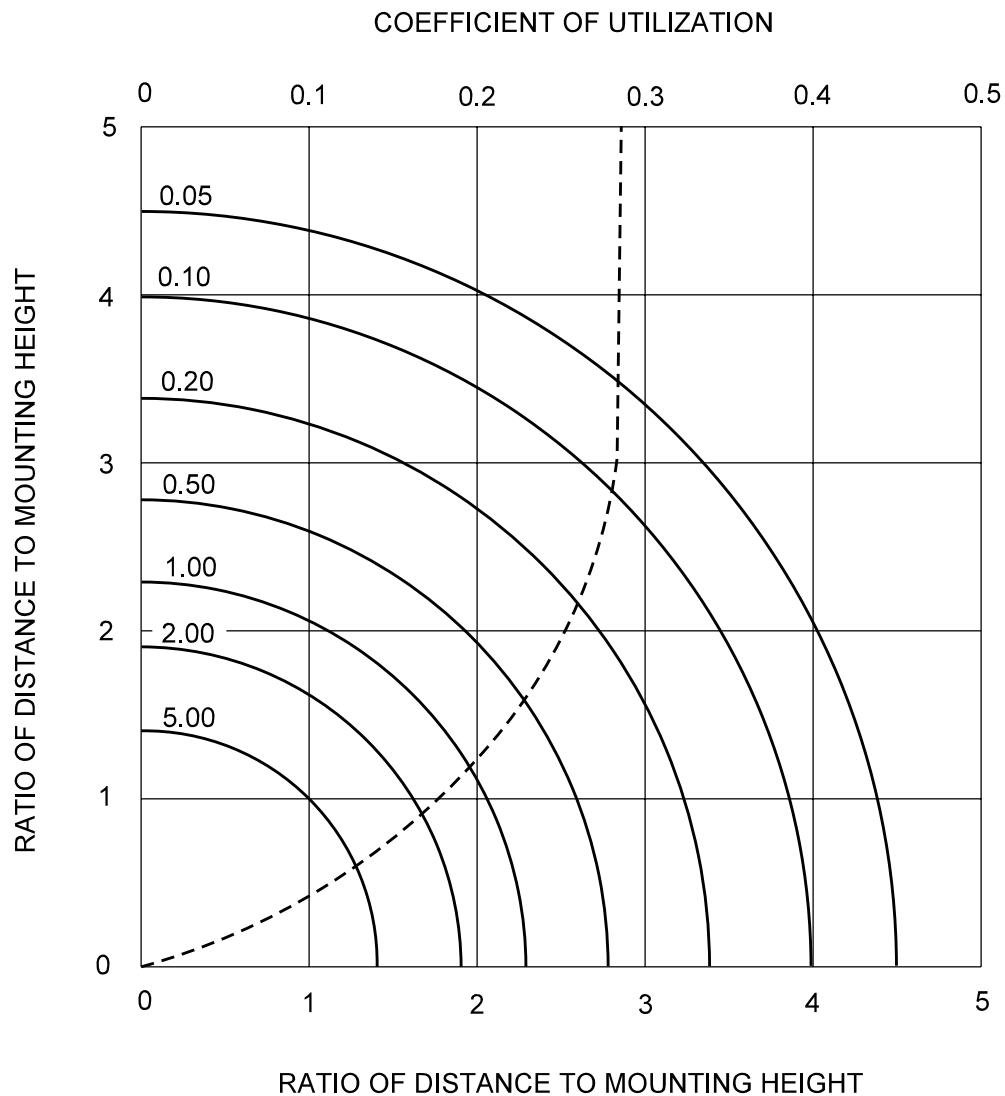

Note: Isolux diagram of horizontal lux on pavement surfaces for a luminaire providing a medium semi-cutoff, Type III light distribution (per 1000 initial lamp lumens). The isolux multiply data are based on a luminaire mounting height of 30 m. For other mounting heights, the values of isolux shown by the factors below.

Mounting Height (m):	18	21	24	27	30	33	36
Factor:	2.78	2.04	1.56	1.23	1.00	0.83	0.69

SAMPLE ISOLUX DIAGRAM (Example 78-8.2)

Figure 78-8F