



Town Of Edgewood

Town Council

Patricia A. Farran, President
Julie H. Armington
Joseph A. Cook

Curt Farran
Arthur J. Leak
Mike Reed

December 11, 2025

Re: Notice of Unknown Water Service Line Pipe Material

Dear Drinking Water Consumer,

As part of the Environmental Protection Agency's (EPA) requirement to comply with the 1991 Lead and Copper Rule, the EPA 2021 Lead and Copper Rule Revisions, and the subsequent 2023 Lead and Copper Rule Improvements, all Drinking Water Public Water System(PWS) are required to submit a first ever water service line inventory of pipe material to the State of Indiana Department of Environmental Management (IDEM) agency and to notify customers of their service line material if it includes lead pipe material.

This notice contains important information about your drinking water. Please share this information with anyone who drinks and/or cooks using water at this property. In addition to the people directly served at this property, this should include people in apartments, nursing homes, schools, businesses, as well as parents served by childcare at this property.

The Edgewood Water Department, PWSID #IN5248006, is focused on protecting the health of every household in our community and prides itself on delivering safe, reliable drinking water to every water customer. Edgewood Water Department complies with all EPA and IDEM drinking water regulations. Regarding the potential of lead in your drinking water, the Edgewood Water Department has not exceeded any of the average drinking water tests that has been performed. If you would like information regarding the state required tests for drinking water, you can view your Annual Drinking Water Report on the Town's website on the Water Department page under Water Quality Report.

The Water Utility has been working to identify service line materials throughout the water system and it has been determined that either a portion of, or the entire water pipe (called a service line) that connects to the water main is made from **unknown pipe material**. Please contact us if you are interested in aiding us in the identification of your customer-side water service line.

If you have questions concerning any of the information provided in this notice, or if you have information that could help us better describe your service line, contact the Water System Contact Person at:

Name: Town of Edgewood Utility Office

Phone: 1-765-649-5534

Health effects of lead

Exposure to lead in drinking water can cause serious health effects in all age groups. Infants and children can have decreases in IQ and attention span. Lead exposure can lead to new learning and behavior problems or worsen existing learning and behavior problems. The children of women who are exposed to lead before or during pregnancy can have





Town Of Edgewood

Town Council


Patricia A. Farran, President
Julie H. Armington
Joseph A. Cook

Curt Farran
Arthur J. Leak
Mike Reed

Dear Water Customer,

Please assist the Town of Edgewood Water Department to complete the required Water Service Line (SL) Inventory which is a requirement of the Environmental Protection Agencies (EPA) Lead and Copper Rule Improvements (LCRI) Rule. While the Town has not previously encounter Lead SL's, the EPA still requires the Town to identify both the utility-owned service line side and the customer-owned service line.

UTILITY-OWNED VS. CUSTOMER-OWNED PORTION OF THE SERVICE LINE

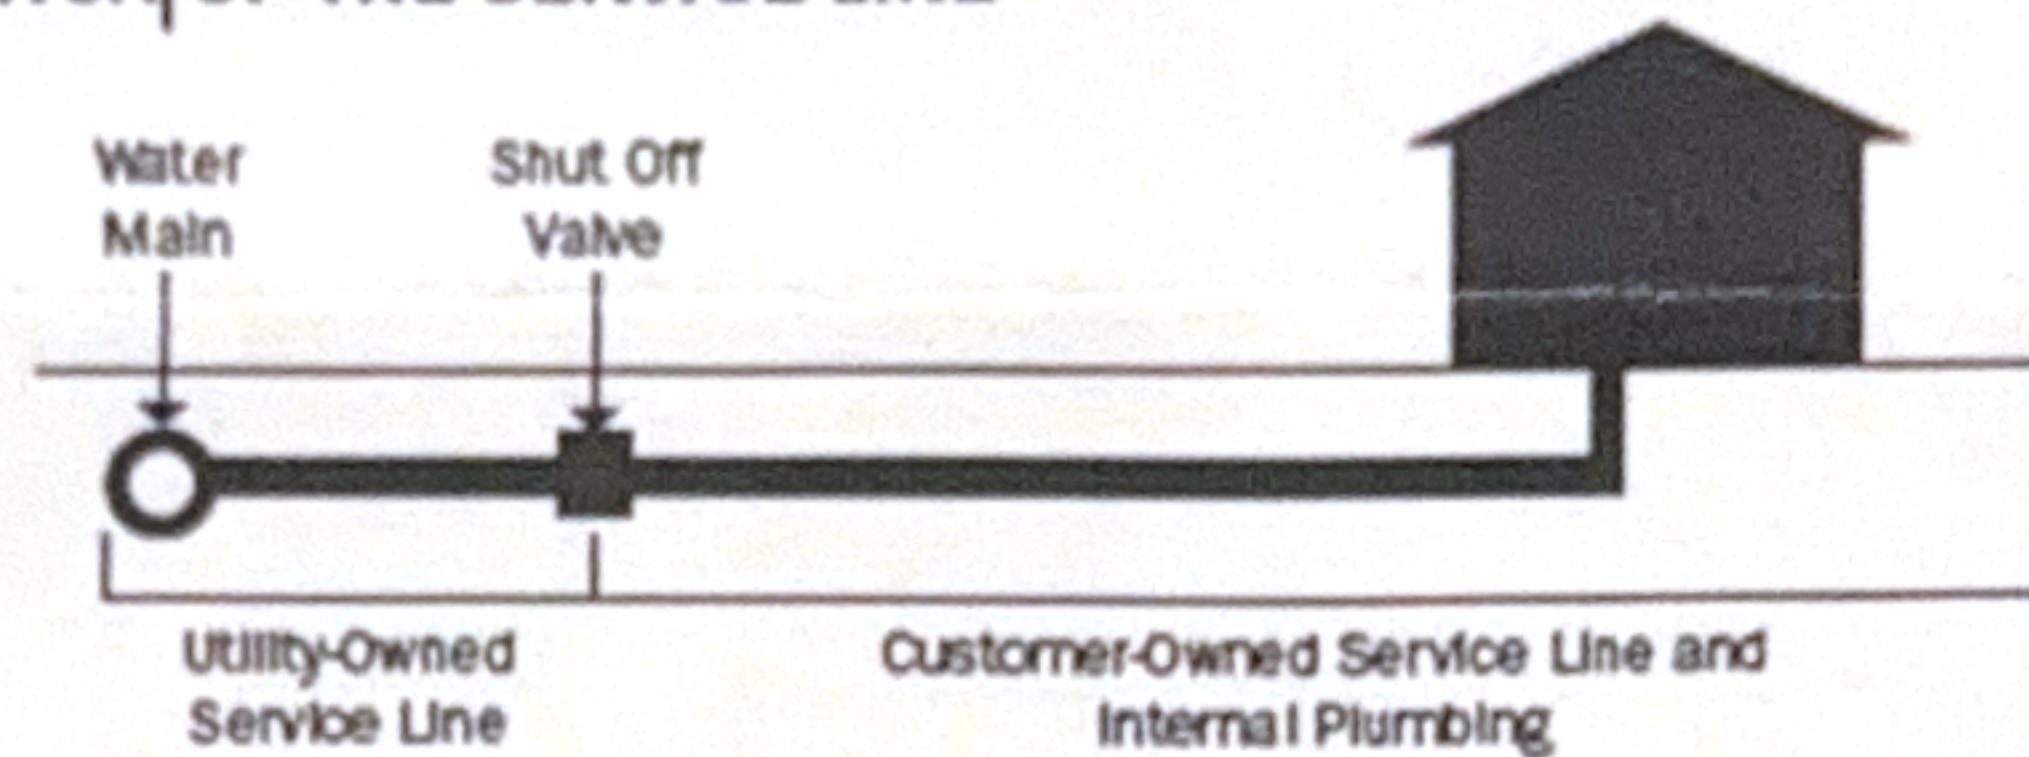


Additionally, the Town has never exceeded any Lead water quality standards establish by the EPA or State of Indiana. To view the Town's Water Quality Report, please visit the Town of Edgewood website (www.in.gov/towns/edgewood/) under Town Services, the Water & Wastewater link.

You can help us in 3 easy Steps:

1. Take a high-quality photo of the water service line where it enters your premise. This is typically where your main water shut is in your house. This location could be through a basement wall, in a utility closet, in your garage, or in your crawl space.
2. Email us at the Water Superintendents office at the following email address:
➤ supt.edgewoodindiana@gmail.com
3. Please include the picture that you took, your address, and water account number so we can properly record your service line pipe material.

If you also want to include what your service line pipe material is made out of you can include that as well. See the digraph below of various pipe types.

TYPES OF PIPE

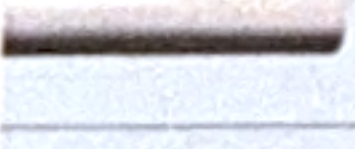	• Galvanized: A dull, silver-gray color. Use a magnet - strong magnets will typically cling to galvanized pipes.
	• Copper: The color of a copper penny.
	• Plastic: Usually white, rigid pipe that is jointed to water supply piping with a clamp. Note: It can be other colors, including blue and black.
	• Lead: A dull, silver-gray color that is easily scratched with a coin. Use a magnet - strong magnets will <u>not</u> cling to lead pipes.

Lastly, if you need assistance finding your water service line pipe where it enters your house, please email me at supt.edgewoodindiana@gmail.com and we can schedule an appointment to perform a service call and assist you in finding your water service line.

Your assistance is appreciated